


EXCAVATE EXISTING SURFACE TO MIN. 150mm BELOW FINISHED SURFACE LEVELS AND CONSTRUCT CONCRETE PATHWAY WITH:

- 100mm THICK N25 REINFORCED CONCRETE SLAB (F42 PLACED CENTRALLY). REFER TO SPECIFICATION FOR COMPOSITION AND FINISHING.
- 50mm OF COMPACTED CRUSHED ROCK (CLASS 2)
- BUILD UP WITH APPROVED COMPACTED SUBSOIL (WHERE NECESSARY)

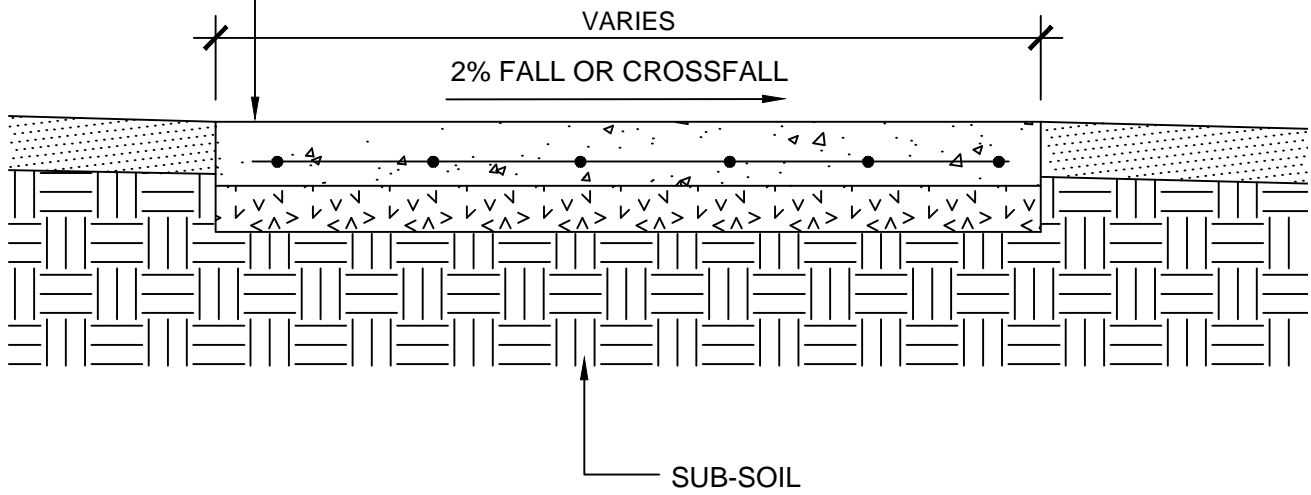

Yarra Standard: YSD410

Drawing Title:
Paving - (Open Space)
Exposed Aggregate Concrete Path
Pedestrian

Scale at A4 1: 10

| REV | DATE | DRAWN BY |
|-----|----------|----------|
| A | 06/09/02 | |
| B | 30/04/12 | DKC |
| C | 18/12/12 | DKC |
| | | |
| | | |

